



14000 Burn Rd  
Arlington, WA 98223  
USA  
Ph (425)374-9060  
www.midnitesolar.com

## MNBE-B Instructions

# Battery Enclosure Installation Instructions



## **IMPORTANT SAFETY INSTRUCTIONS**

**SAVE THESE INSTRUCTIONS** - These instructions contain important safety and operating instructions for the MidNite Solar Battery Enclosure Size B for residential and commercial applications.

If you do not fully understand any of the concepts, terminology, or hazards outlined in these instructions, please refer installation to a qualified dealer, electrician or installer. These instructions are not meant to be a complete explanation of a renewable energy system.

### **GENERAL PRECAUTIONS**

**WORKING WITH OR IN THE VICINITY OF A LEAD ACID BATTERY, SEALED OR VENTED IS DANGEROUS. VENTED BATTERIES GENERATE EXPLOSIVE GASES DURING NORMAL OPERATION. FOR THIS REASON, IT IS VERY IMPORTANT THAT BEFORE SERVICING EQUIPMENT IN THE VICINITY OF LEAD-ACID BATTERIES, YOU REVIEW AND FOLLOW THESE INSTRUCTIONS CAREFULLY.**

If service or repair should become necessary, contact MidNite solar Inc. Improper servicing may result in a risk of shock, fire or explosion. To reduce these risks, disconnect all wiring before attempting any maintenance or cleaning. Turning off the inverter will not reduce these risks. Solar modules produce power when exposed to light. When it is not possible to disconnect the power coming from the Photovoltaics by an external means such as a combiner, cover the modules with an opaque material before servicing any connected equipment.

Never attempt to charge a frozen battery..

When it is necessary to remove a battery, make sure that the battery bank disconnect breaker is in the off position and that the PV breakers, grid breakers and any other sources of power to the inverter are in the off position. Then remove the negative terminal from the battery first.

To reduce risk of battery explosion follow these instructions and those published by the battery manufacturer as well as the manufacturer of any additional equipment used in the vicinity of the batteries. Before installing the battery enclosure, read all instructions and cautionary markings in or on any connected electrical equipment.

Avoid producing sparks in the vicinity of the batteries when using vented batteries. Provide ventilation to clear the area of explosive gases. Sealed AGM and Gel batteries do not under normal conditions create explosive gases. Be especially cautious when using metal tools. Dropping a metal tool onto batteries can short circuit them. The resulting spark can lead to personal injury or damage to the equipment. Provide ventilation to outdoors from the battery compartment when installing vented batteries such as golf cart T-105 batteries. The addition of a spill tray is also a good idea.

Clean all battery terminals. Very high currents are drawn from the batteries; even a small amount of electrical resistance can result in overheating, poor performance, premature failure or even fire.

## MNBE-B Instructions (continued)

---

Have plenty of fresh water and soap nearby in case battery acid contacts skin, clothing or eyes. Wear complete eye and clothing protection. Always avoid touching eyes while working near batteries. If battery acid or battery terminal corrosion contacts skin or clothing, wash immediately with soap and water. If acid enters the eyes, immediately flood with cool running water for at least 15 minutes and get medical attention immediately. Baking soda neutralizes battery acid electrolyte. Keep a supply near the batteries.

Do not work alone. Someone should be in the range of your voice or close enough to come to your aid when you work with or near electrical equipment.

Remove rings, bracelets, necklaces, watches etc. when working with batteries, photovoltaic modules or other electrical equipment. Power from an illuminated photovoltaic array makes a very effective arc welder with dire consequences if one of the welded pieces is on your person.

To reduce the risk of injury, connect only deep cycle lead acid type rechargeable batteries. Other types of batteries may leak or burst, causing personal injury or damage.

### **Preparation:**

You will require a #2 Philips screw driver and a 5/16" wrench to tighten screws, as well as a slotted screw driver and hammer to remove knockouts.

### **Step 1:**

Attach shelves to the two sides as shown below.  
Use eight #10 x 3/8" pan head Philips SS sheet metal screws.



### **Step 2:**

Install front and

eight #10 x 3/8" Flat head Philips SS sheet metal screws back to attach sides to shelves.



#10 x 3/8" Stainless Steel  
Flat head sheet metal screw



Example of screw in Step 2

## MNBE-B Instructions (continued)

---

### Step 3:

Install the back panels. Both panels are identical. Make sure to orient them so that the knock outs are located in the upper half of the panel. You will use ten #10 x 3/8" Pan head Philips SS sheet metal screws.



#10 x 3/8" Stainless Steel  
Pan head sheet metal screw



Four of the ten screws shown from  
Step 3



Two screws attach under each shelf to the  
backs from Step 3

### Step 4:

Attach the top using four #10 x 3/8" Pan head Philips SS sheet metal screws. Orient the top such that the 2" knock out is located to the rear of the enclosure.



## MNBE-B Instructions (continued)

---

### Step 5:

Attach the left door

Each hinge will use three #10 x 3/8" Flat head screws to secure the hinge to the sides.



Snug the screws up to the hinge, but do not over tighten.

### Step 6:

Attach the left door using 6-32 flat head screws and kepnuts.



6-32 kepnuts on the inside of door



Left door has a lip as shown

### Step 7:

Attach the right door in the same manner as the left one.



Right door shown installed

## MNBE-B Instructions (continued)

---

### Step 8:

Snap the plastic handle hold into the rectangle hole on the right door as shown.



### Step 9:

Assemble the lock in the double D hole as shown.

Note: It may require a bit of adjustment on the cam in order to align with slot in the bottom of shelf.




Your Battery enclosure is now fully assembled.

Before placing batteries on shelves, make sure the enclosure is in its final location. It will be too heavy to move once batteries are installed.

If batteries are to be strapped down, use the oblong holes at the ends of the shelves to go between the top side and the bottom side of the shelf. . The straps, (not supplied) need to be fed under the bottom shelf prior to installing batteries.


The battery enclosure may be bolted down to the floor using the four holes located on the side flanges. Mounting holes will accept up to 3/8" bolts. Use a thick, wide flat washer as a back up underneath the bolt head to add to the pull through strength.

The MNBE-8 is designed to hold 8 group 31 or group 27 batteries as well as T-105's.



T-105's  
(sealed)

You must use  
batteries when

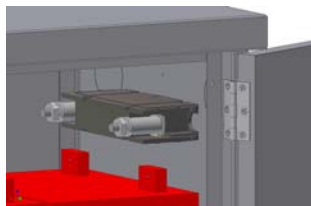

With  
MNDC250  
breaker

sealed AGM or Gel  
installing a circuit


## MNBE-B Instructions (continued)

breaker/disconnect in one of the side panels as shown above. Circuit breakers make sparks and vented batteries cannot be in the same cabinet with any device that makes arcs or sparks. A circuit breaker installed as shown must be inserted in the battery positive lead. Do not install in the negative leg.

Two battery enclosures may be connected together side by side for additional storage. 2" conduit knock outs are provided on each side of the enclosure to accommodate this configuration. Use a 6" long conduit to connect the two cabinets together.

### Battery Configuration:


The MNBE-B is designed for eight batteries. The following diagrams show three different ways to configure the battery bank. This is not meant to show all methods of inter-connecting the battery bank.

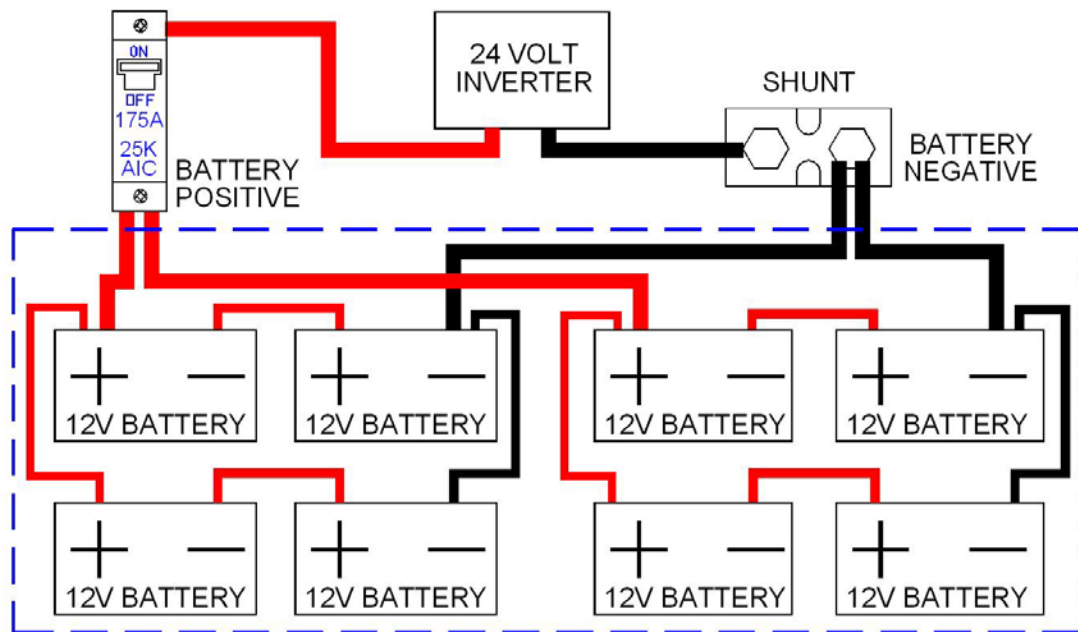

This configuration shows a 24 volt hook up using 12 volt group 31 batteries. Notice that in this configuration there are 4 parallel strings. Parallel strings can be a problem when too many are involved in cyclic applications such as in an off-grid installation. This set up poses no problems in a power back up application where batteries are normally floated. In an off-grid home, this battery bank would not be large enough for acceptable performance. You could add a couple more battery enclosures side by side, but the quantity of paralleled strings using these 12 volt batteries would be excessive. It would be advisable to go to 6 volt golf cart sized batteries to cut the paralleled strings in half. Battery boxes stacked vertically on top of each other.  $\frac{3}{4}$ " pieces of wood are inserted inside the top panel to support the extra weight and give a place to screw to.




## MNBE-B Instructions (continued)

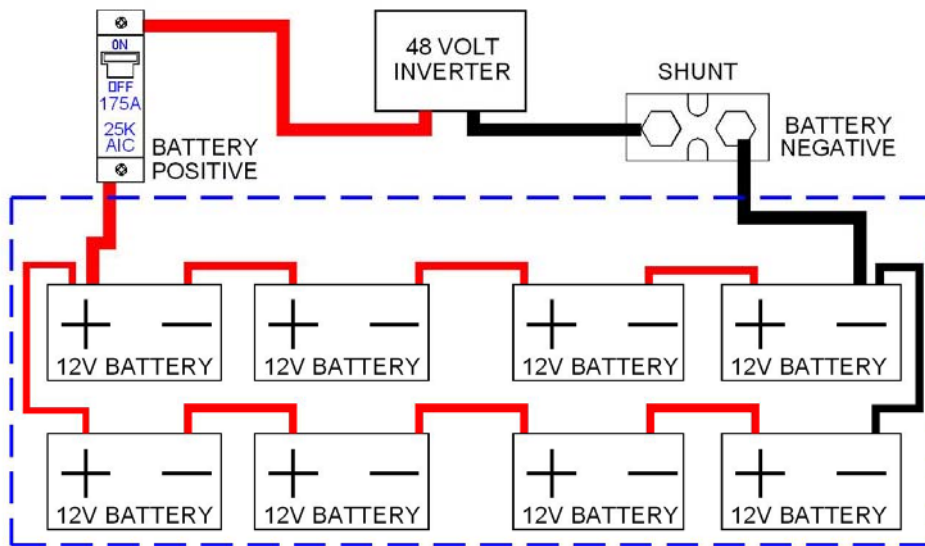

This configuration utilizes the same 12 volt group 31 batteries, but hooked up for 48 volts. There are only 2 paralleled strings in this system. A second battery enclosure may be installed side by side or on top of each other for double the capacity.

Rumors persist in the industry that the higher voltage battery banks will not supply as much power as a low (12V) bank. This is simply not true. Take 8 group 31 batteries. Each battery is rated at 105 amp hours at 12 volts. Each battery is thus good for 1260 watt hours. Eight of these batteries yields 10,080 watt hours. No matter how these batteries are configured, they will still be the same watt hour battery bank. Be careful when looking at “amp hour” ratings. You also need to consider the voltage. Volts times amp hours yields watt hours. This 10,080 watt hour battery bank conceivably could run a 10,000 watt light bulb for 1 hour or a 1 watt light bulb for 10,000 hours. In power back up applications, count on using up 80% of the watt hour rating. In cyclic applications you should not go lower than 50% depth of discharge.

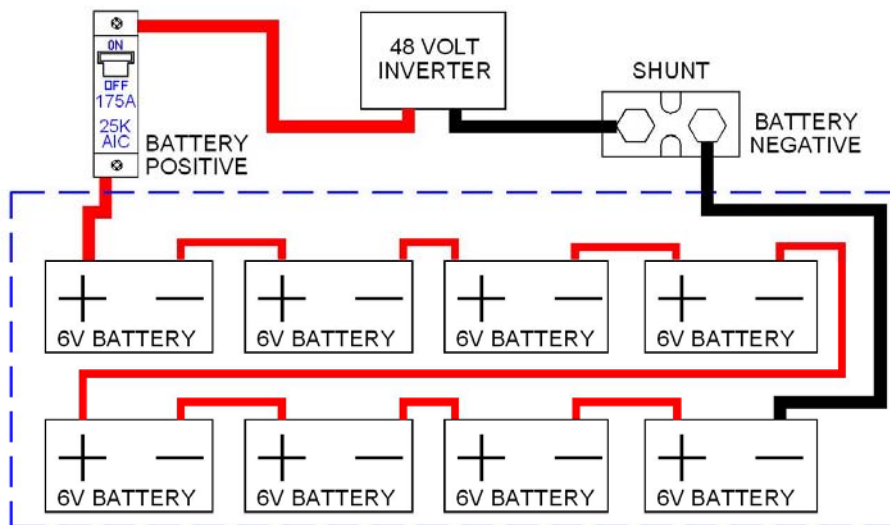

This configuration uses 6 volt sealed batteries that result in only one string. This is a 48 volt battery bank. You could add 3 more cabinets and have only 4 paralleled strings.